



\ 1-P28 / SCALE:NO SCALE

HAND SHOWER IN-LINE WATER FILTER - 0.2 MICRONS

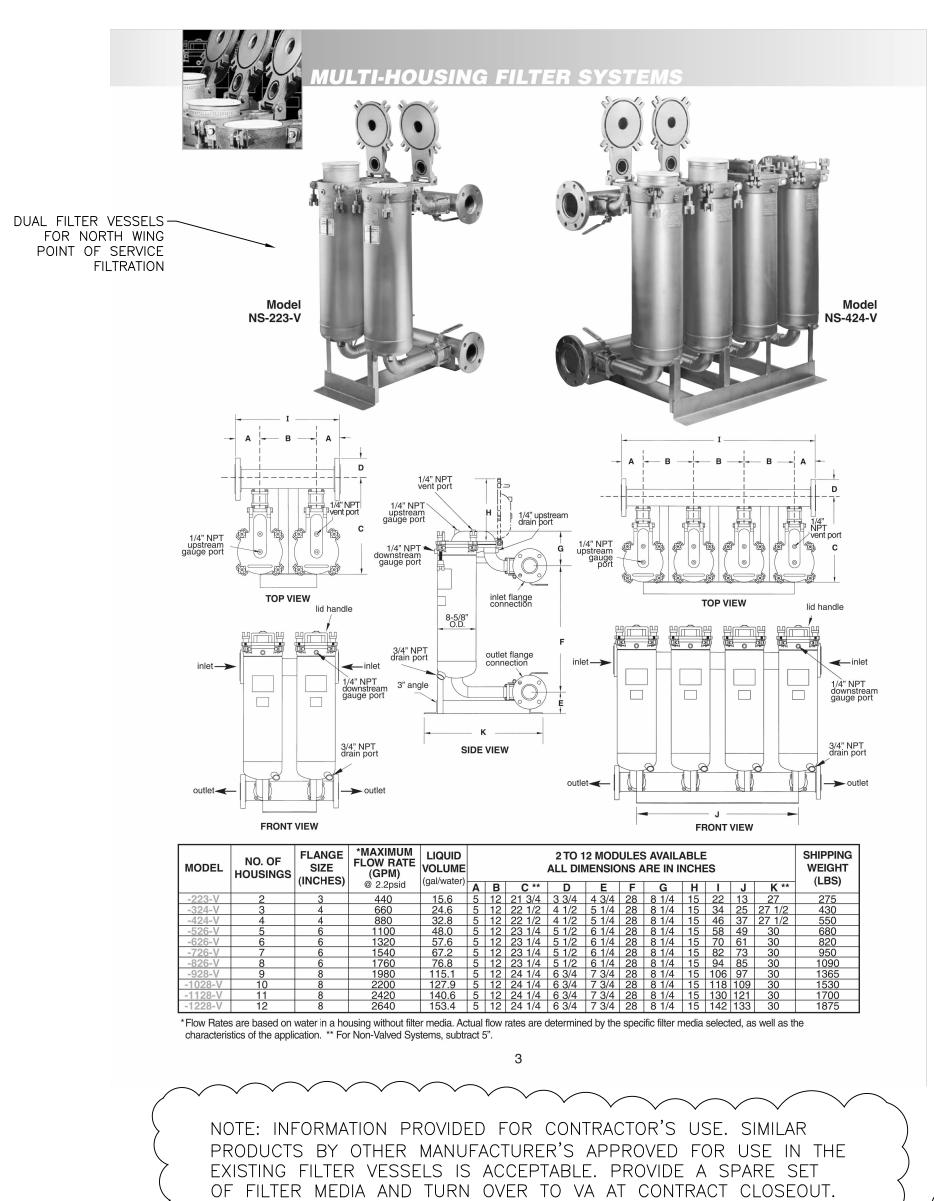

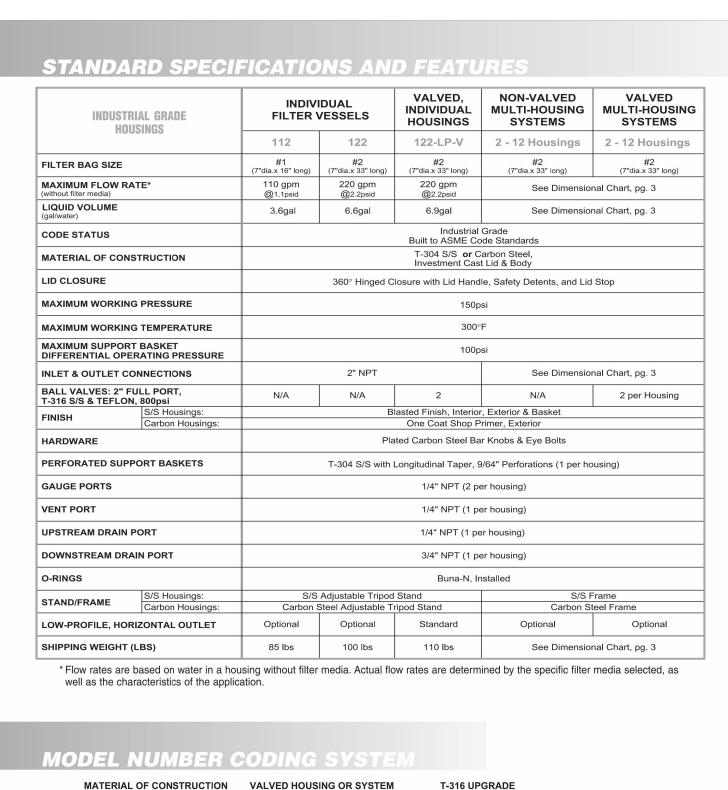

NS = T-304 S/S, Industrial Grade Filtration Systems Inlet & Outlet Optional T-316 Stainless Steel

SV = Sanitary Butterfly Valve

HOUSING SIZE / FILTER BAG SIZE

2 = #2 Size (7" Dia. x 33" Long)

6 = 6" Connection
8 = 8" Connection

NC = Carbon Steel, Industrial Grade

Isolation Valves, T-316 S/S

Upgrade, Including S/S Hardware

V = Ball Valve, 3-Piece, Full-Port

Modified Equipment,
as per guote or requirement

 \overline{NS} - $\underline{223}$ - \overline{V} - $\overline{316}$ - \underline{LP} - \overline{M}


INLET & OUTLET CONNECTION SIZE

Connections available

2 = 2" Connection

as per quote or requirement

LOW-PROFILE, HORIZONTAL OUTLET

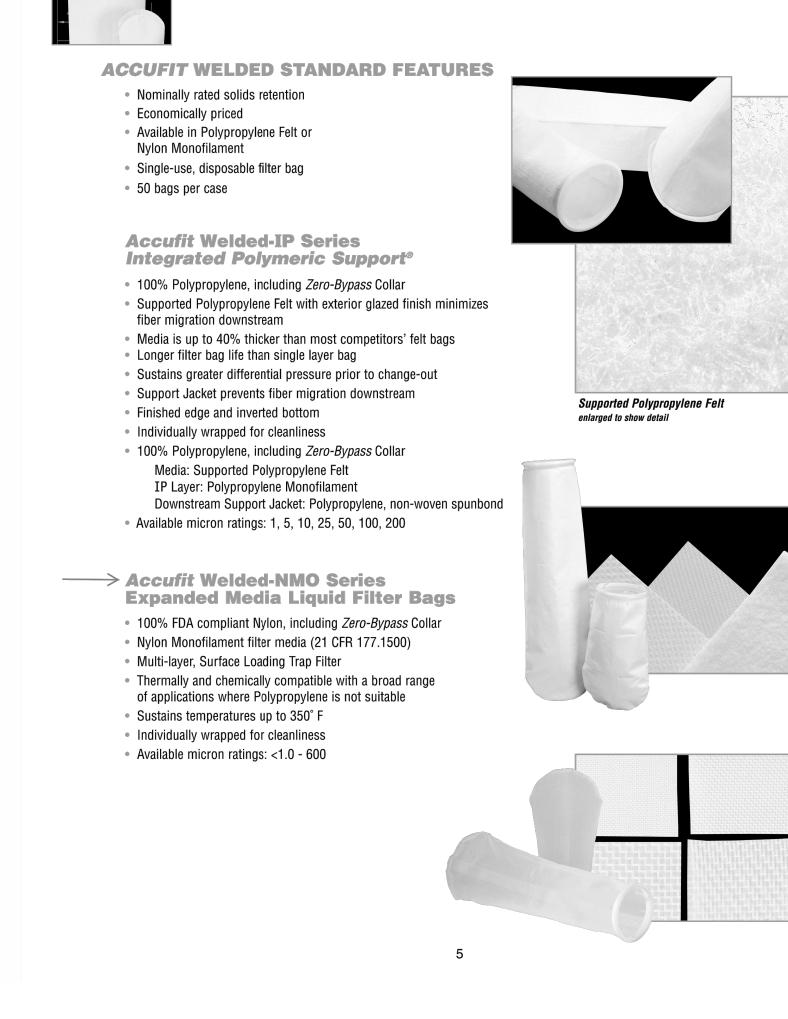

CCUFIT® WELDED LIQUID FILTER BAGS

POINT OF SERVICE WATER FILTER
1.0 MICRON WELDED BAG TYPE \ 1-P28 / SCALE:NO SCALE


NUMBER OF FILTER HOUSINGS

2-12 = Modular Systems


BID AMENDMENT NO.1

SPRINKLERED

AUGUST 24, 2016

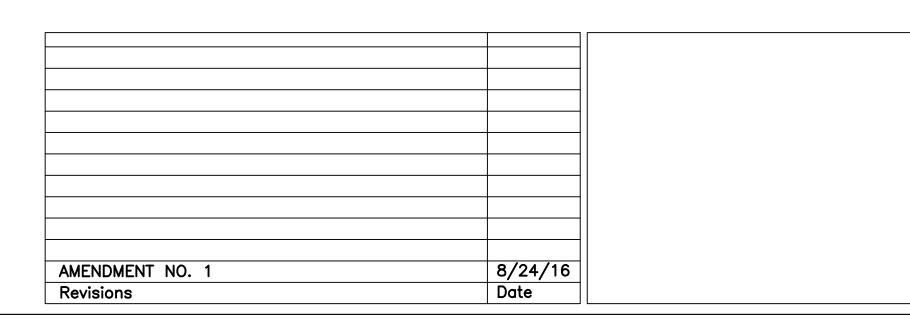



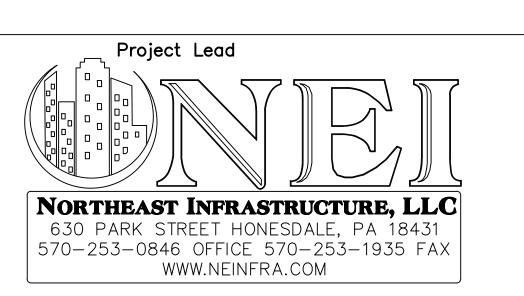

| rawing Title |
|------------------------|
| |
| FILTER DATA |
| |
| |
| acility Project Name |
| DEPARTMENT OF VETERANS |
| AFFAIRS MEDICAL CENTER |
| WILKES-BARRE, PA |
| |

| | | | FULLY S |
|---|-------------------------------------|-------------------|-----------------|
| ving Title | Project Title | | |
| FILTER DATA | PLUMBING SYSTEM UPGRADE PHASE II | | |
| lity Project Name DEPARTMENT OF VETERANS | Building Number | Checked L.J.M. | Drawn R.W.P. |
| AFFAIRS MEDICAL CENTER | Location | | |

WILKES-BARRE, PENNSYLVANIA

08/24/2016 693-11-119 DRAWING NO.
DRAWING
1-P28
DWG. 38 OF 55